
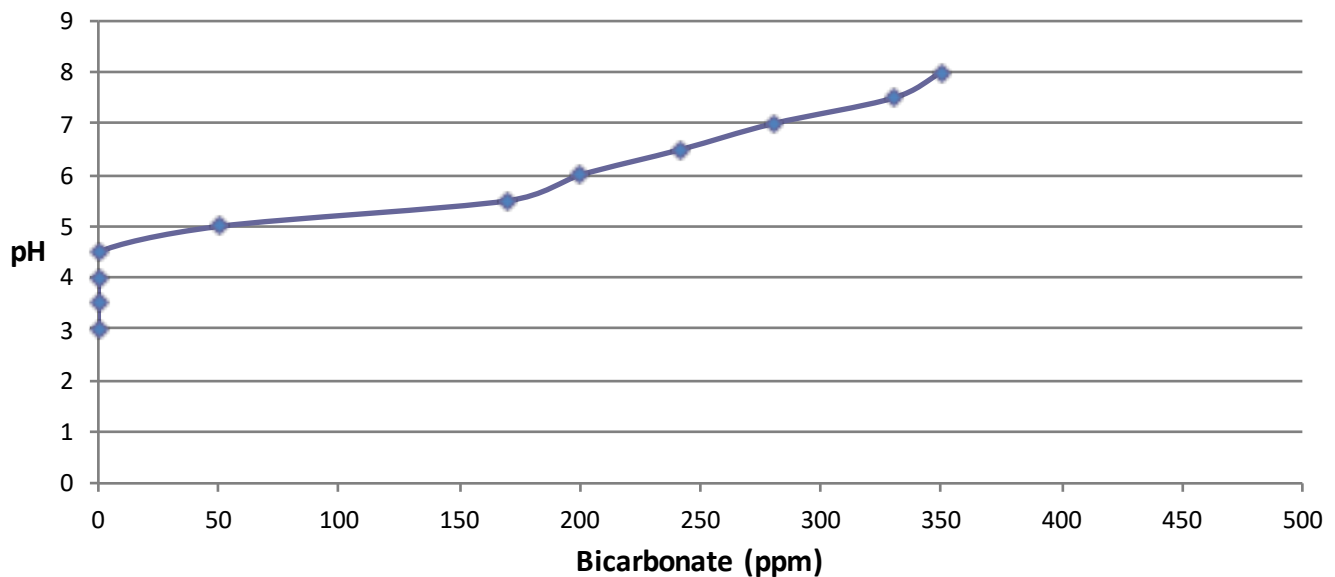


MASEST WS60 Titration Curve

Sigma Sample

Date
10/28/24

Initial pH 8
Initial EC 3.700

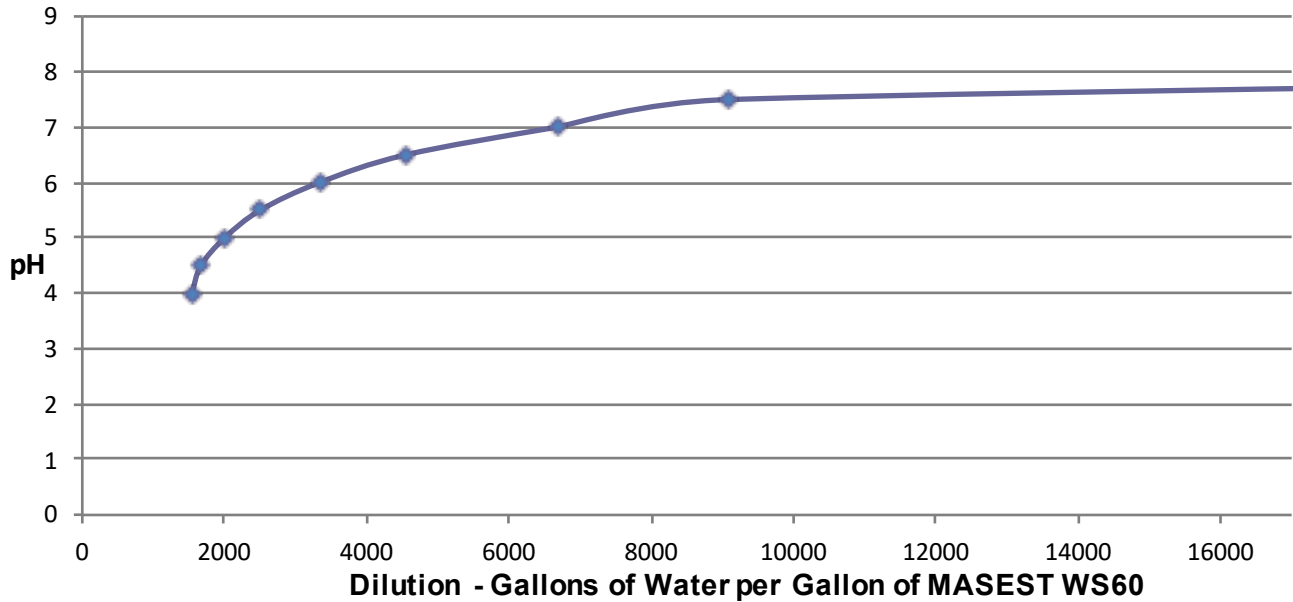

Estimated Buffer Requirements for WS60

Desired pH	oz/1000 gal	gal WS60: gals. water
7.0	14.08	1: 9,091
6.5	19.20	1: 6,667
6.0	28.16	1: 4,545
5.5	38.40	1: 3,333